




Appendix F – RMLD

10-500 kW Photovoltaic System Isolation Schematic

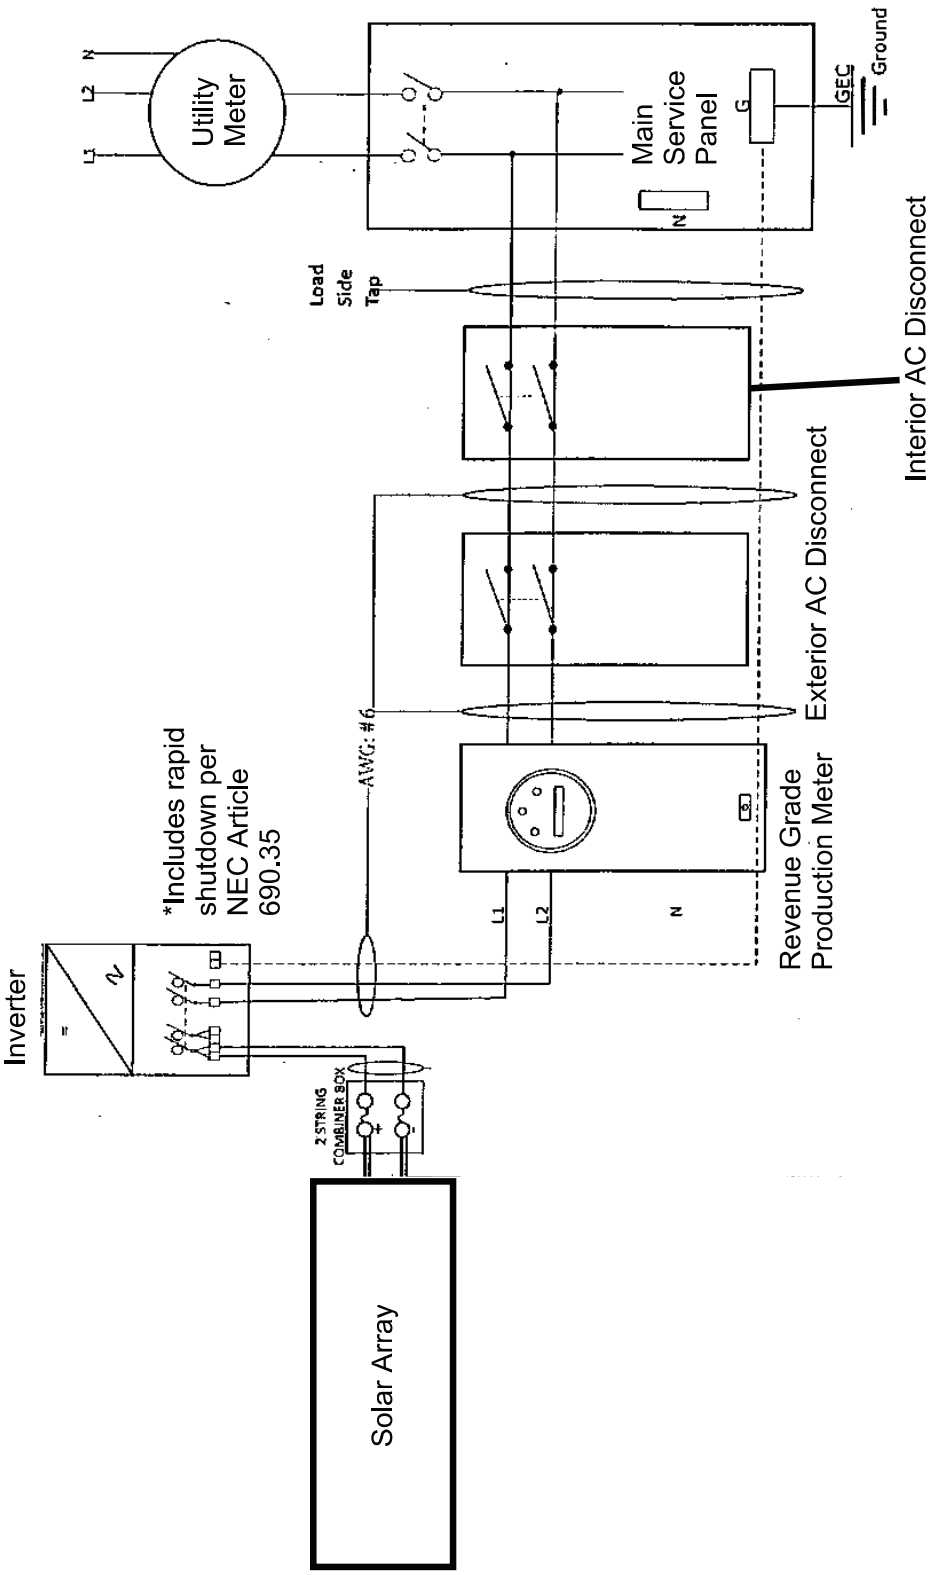

*Includes rapid shutdown per NEC Article 690.35

2 STRING COMBINER BOX

Inverter

Utility Meter

Main Service Panel

Revenue Grade Production Meter

Exterior AC Disconnect

Interior AC Disconnect

GEC Ground

Load Side Tap

Solar Array

AWG: # 6

L1

L2

N

N

G

L1

L2

N